


Remark:

1. The foundation and the support of center sump are at the same level.
2. The height deviation should less than 1/4".
3. Final foundation design must be determined considering the pump's NPSHR.
4. Location of anchors is approximate and final location must be verified on-site by the installer.



SECTION A-A

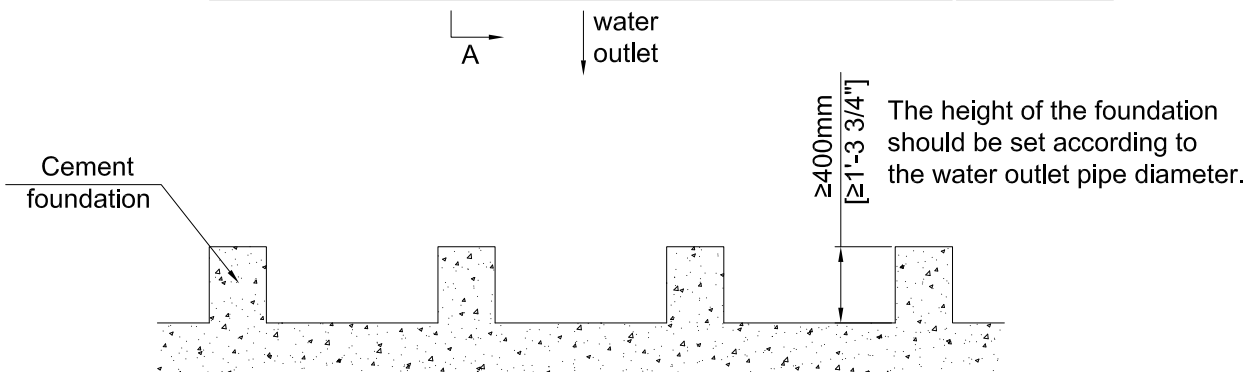


PROJECT / MODEL

# MCC-06A FOUNDATION

TITLE

## MESAN COOLING TOWER

DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
KING	MING	MING	ISA
SCALE	FILE NAME	DATE	
		2014-01-06	
	DRAWING NO.		REVISION
	MCC-06A-F		01