


Remark:

- 1、 The foundation and the support of center sump are at the same level.
- 2、 The height deviation should less than 1/4".
- 3、 Final foundation design must be determined considering the pump's NPSHR.
- 4、 Location of anchors is approximate and final location must be verified on-site by the installer.



SECTION A-A

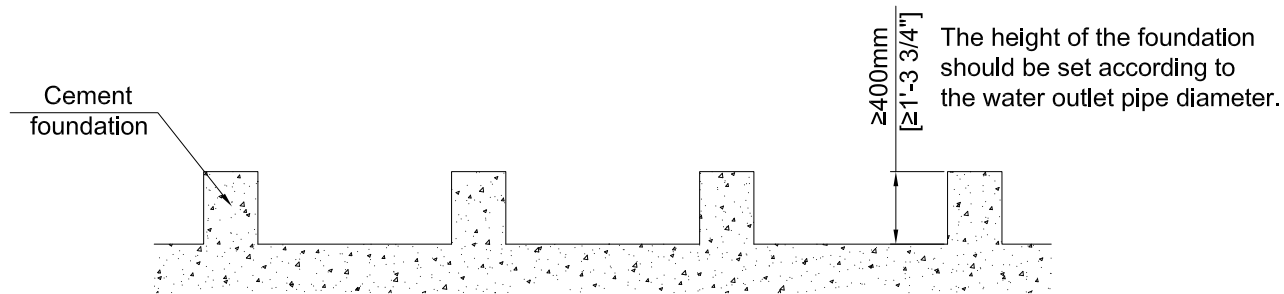

PROJECT / MODEL

**MCC-07B
FOUNDATION**

TITLE

MESAN COOLING TOWER

DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
KING	MING	MING	ISA

SCALE	FILE NAME	DATE
		2014-01-05

	DRAWING NO.	REVISION
	MCC-07B-F	01