

Remark:


1. The foundation and the support of center sump are at the same level.
2. The height deviation should less than 1/4".
3. Final foundation design must be determined considering the pump's NPSHR.
4. Location of anchors is approximate and final location must be verified on-site by the installer.



PROJECT / MODEL
**MCC-08B
 FOUNDATION**

TITLE
MESAN COOLING TOWER

DRAWN BY KING	DESIGNED BY MING	CHECKED BY MING	APPROVED BY ISA
SCALE	FILE NAME	DATE 2014-01-05	
DRAWING NO. MCC-08B-F		REVISION 01	

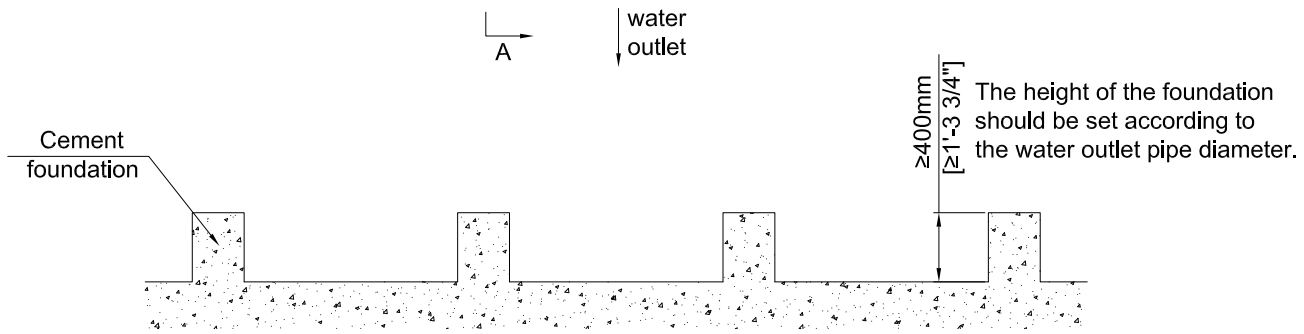

SECTION A-A