



Remark:

- 1、 The foundation and the support of center sump are at the same level.
- 2、 The height deviation should less than 1/4".
- 3、 Final foundation design must be determined considering the pump's NPSHR.
- 4、 Location of anchors is approximate and final location must be verified on-site by the installer.

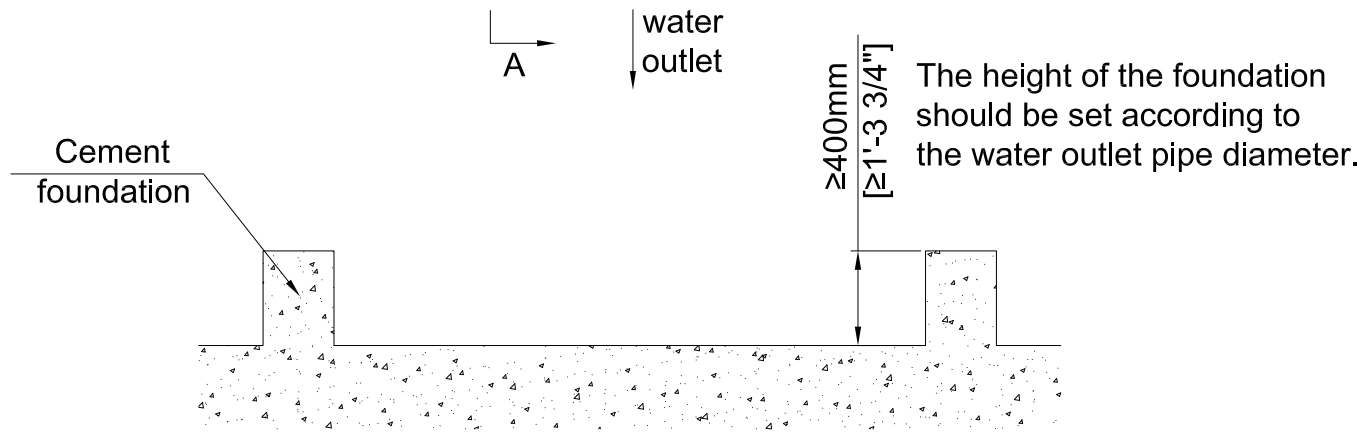

SECTION A-A

			
PROJECT / MODEL			
<b>MCC-12B FOUNDATION</b>			
TITLE			
<b>MESAN COOLING TOWER</b>			
DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
KING	MING	MING	ISA
SCALE	FILE NAME	DATE	
		2014-01-05	
DRAWING NO.		REVISION	
MCC-12B-F		01	