


The height of the foundation should be set according to the water outlet pipe diameter.



- Remark:
1. The foundation and the support of center sump are at the same level.
 2. The height deviation should be less than 1/4".
 3. Final foundation design must be determined considering the pump's NPSHR.

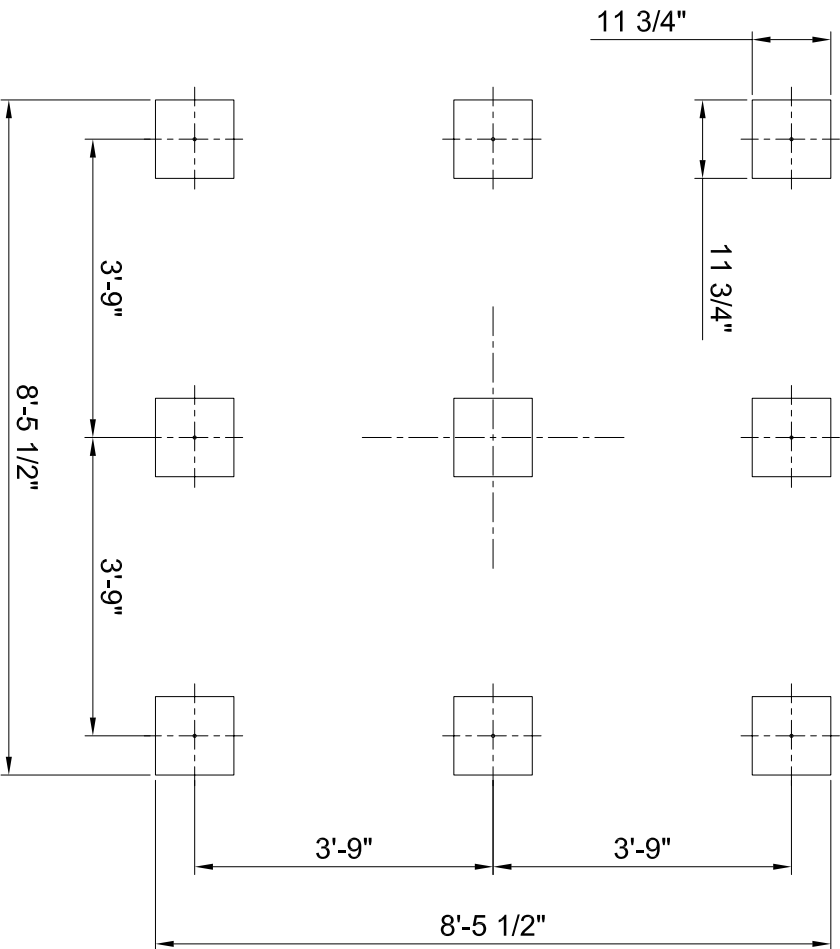

PROJECT / MODEL

MCR-2301
FOUNDATION

TITLE

MESAN COOLING TOWER

DRAWN BY DESIGNED BY CHECKED BY APPROVED BY

Xian

Alice

Isa

Isa

SCALE FILE NAME

DATE

2012-05-03

DRAWING NO.

REVISION

01

