


The height of the foundation should be set according to the water outlet pipe diameter.

Remark:

1. The foundation and the support of center sump are at the same level.
2. The height deviation should be less than 1/4".
3. Final foundation design must be determined considering the pump's NPSHR.

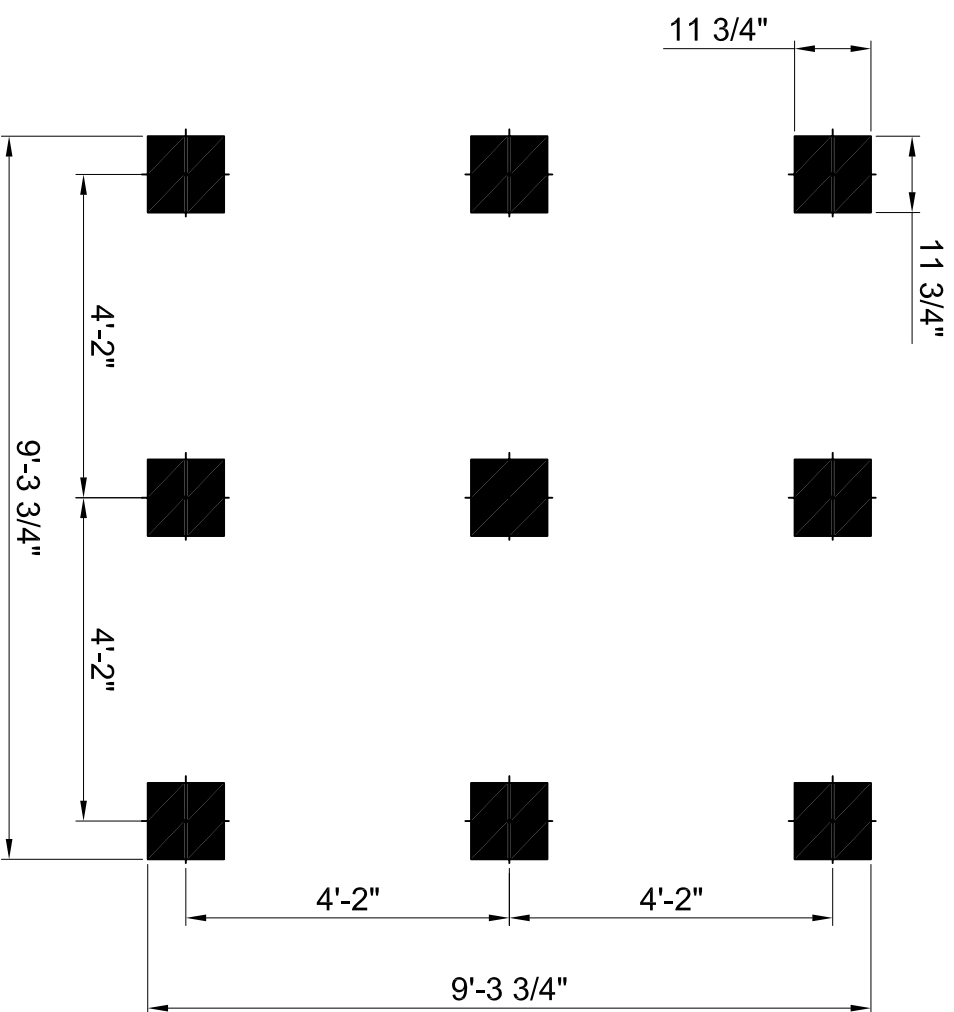

PROJECT / MODEL
MCR-2303
FOUNDATION

TITLE
MESAN COOLING TOWER

DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
Xian	Alice	Isa	Isa
SCALE	FILE NAME	DATE	
		2012-05-03	
	DRAWING NO.	REVISION	
		01	

