


The height of the foundation should be set according to the water outlet pipe diameter.

Remark:

1. The foundation and the support of center sump are at the same level.
2. The height deviation should be less than 1/4" .
3. Final foundation design must be determined considering the pump's NPSHR.

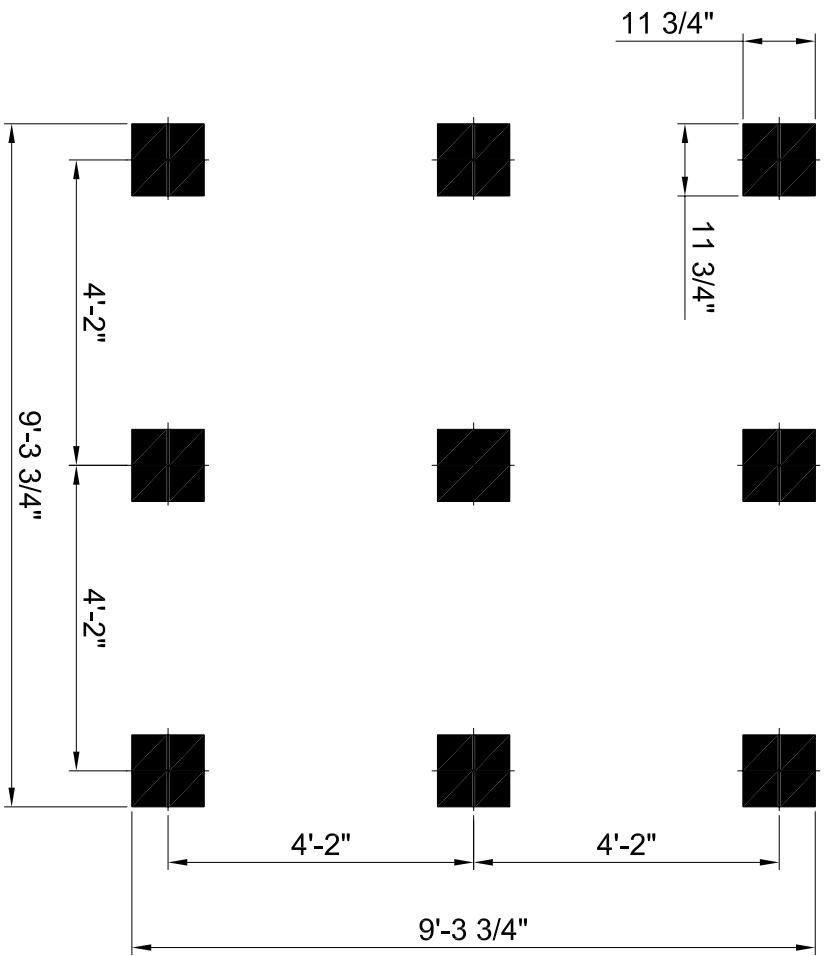

PROJECT / MODEL
MCR-2304
FOUNDATION

TITLE		DESIGNED BY		CHECKED BY		APPROVED BY	
MESAN COOLING TOWER		Xian	Alice	Isa	Isa		
		SCALE	FILE NAME	DATE			
		DRAWING NO.		REVISION			
				2012-05-03		01	