



The height of the foundation should be set according to the water outlet pipe diameter.

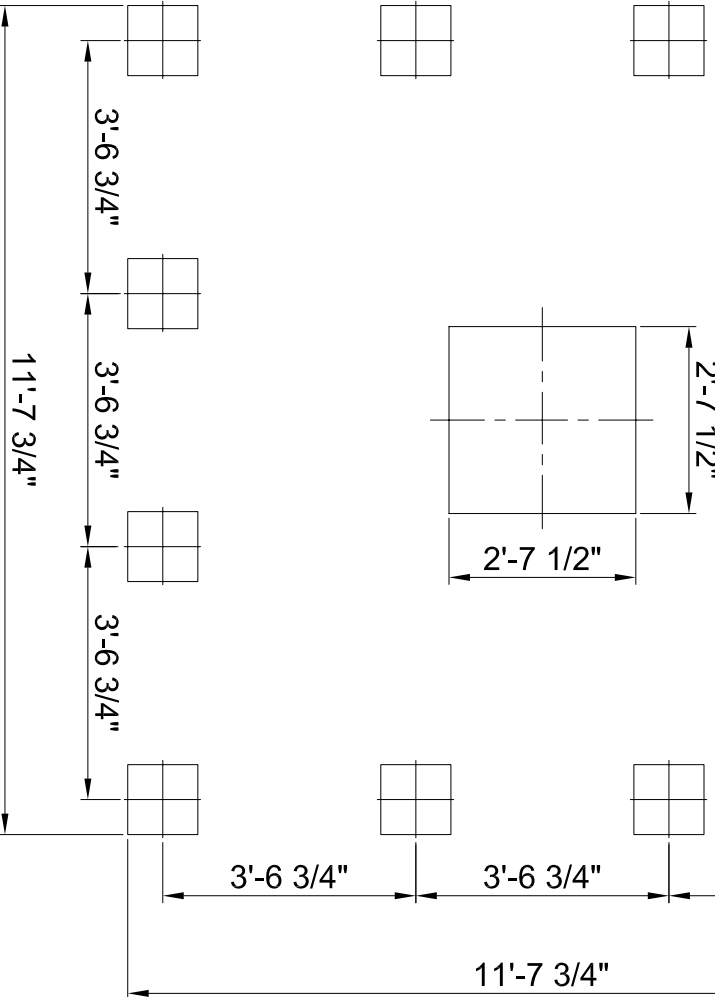

**Remark:**

1. The foundation and the support of center sump are at the same level.
2. The height deviation should be less than 1/4".
3. Final foundation design must be determined considering the pump's NPSHR.

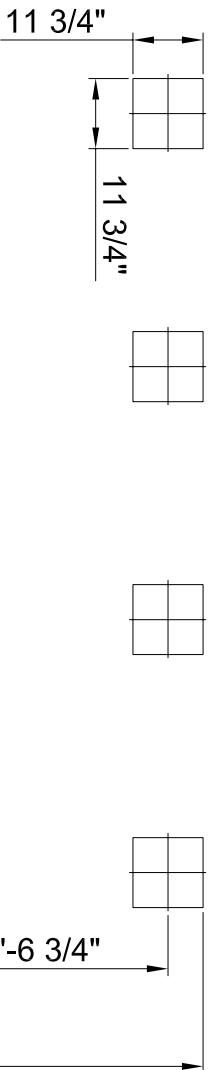

PROJECT / MODEL

MCR-2305  
FOUNDATION

TITLE

MESAN COOLING TOWER

DRAWN BY DESIGNED BY CHECKED BY APPROVED BY

Xian Alice Isa Isa

SCALE FILE NAME DATE

2012-05-03

DRAWING NO. REVISION

01

