



The height of the foundation should be set according to the water outlet pipe diameter.

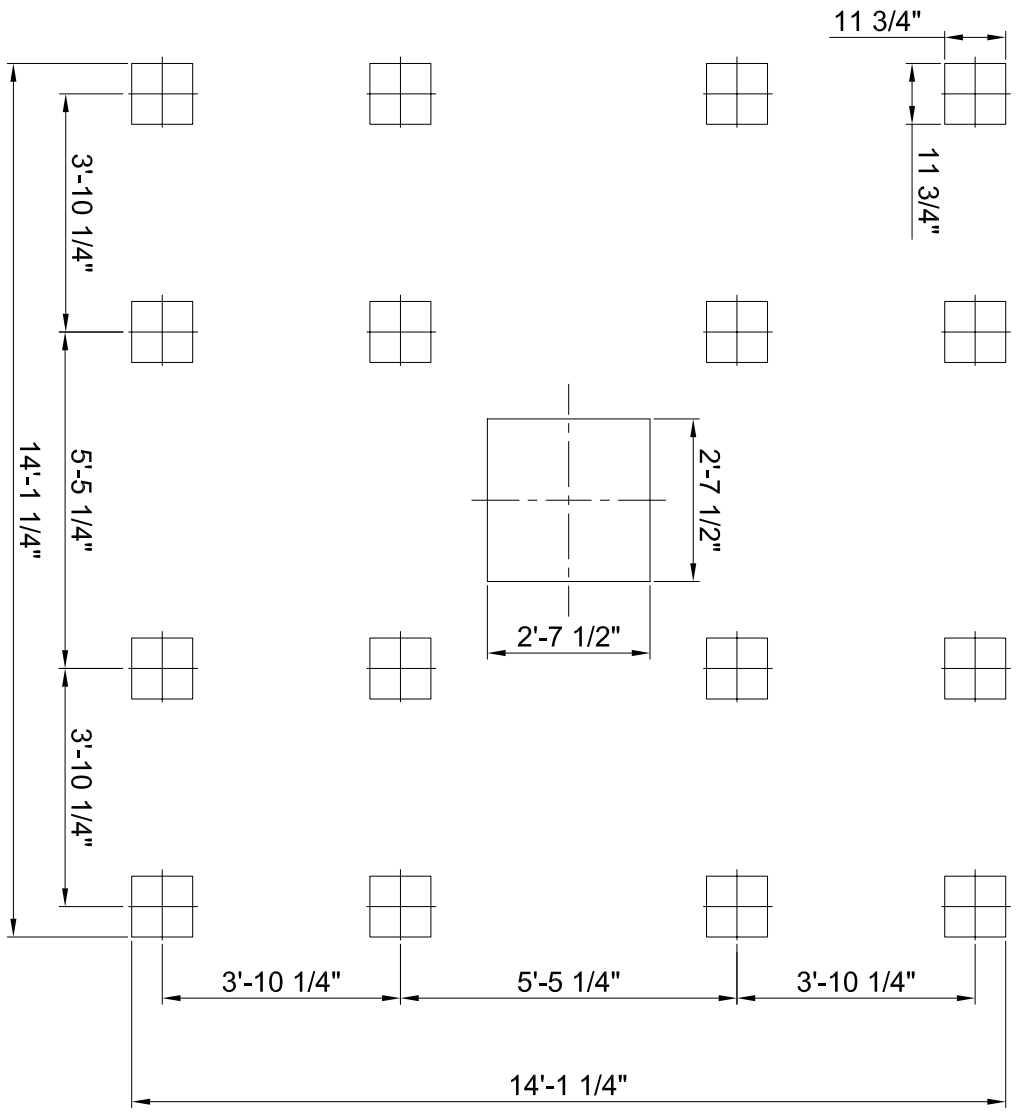

- Remark:
1. The foundation and the support of center sump are at the same level.
 2. The height deviation should be less than 1/4".
 3. Final foundation design must be determined considering the pump's NPSHR.

			
PROJECT / MODEL			
MCR-2307			
FOUNDATION			
TITLE			
MESAN COOLING TOWER			
DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
Xian	Alice	Isa	Isa
SCALE	FILE NAME	DATE	REVISION
		2012-05-03	01
DRAWING NO.			REVISION