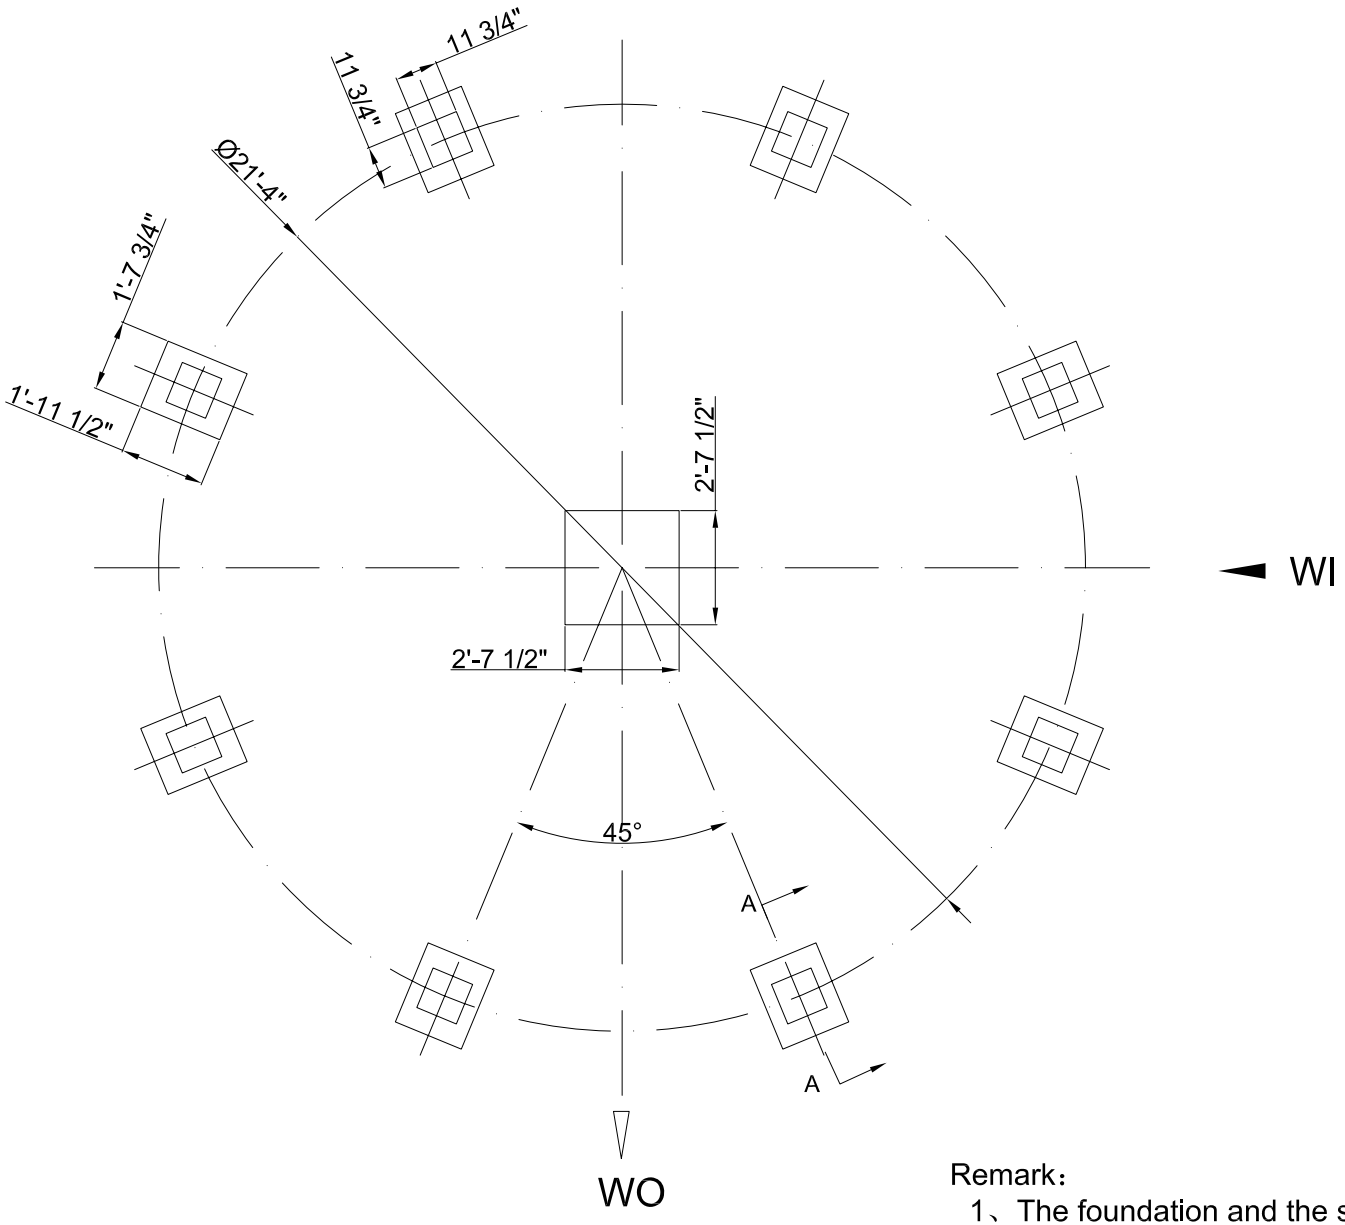

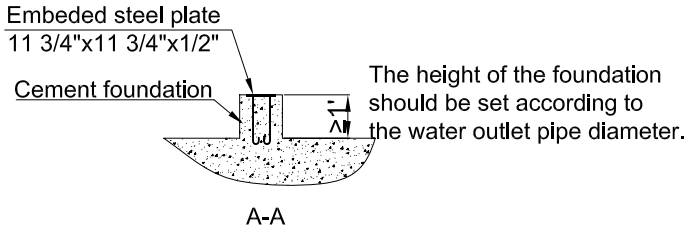

Remark：

1、The foundation and the support of center sump are at the same level.
2、The height deviation should less than 1/4".
3、Final foundation design must be determined considering the pump's NPSHR.
4、The operating weight is 26896 lbs。

PROJECT / MODEL: MKT-500 FOUNDATION			
TITLE: MESAN COOLING TOWER			
DRAWN BY: xin	DESIGNED BY: xin	CHECKED BY: Alice	APPROVED BY: Isa
SCALE	FILE NAME		DATE: 2012-05-03
	DRAWING NO.		REVSION: 01