


▽
WO

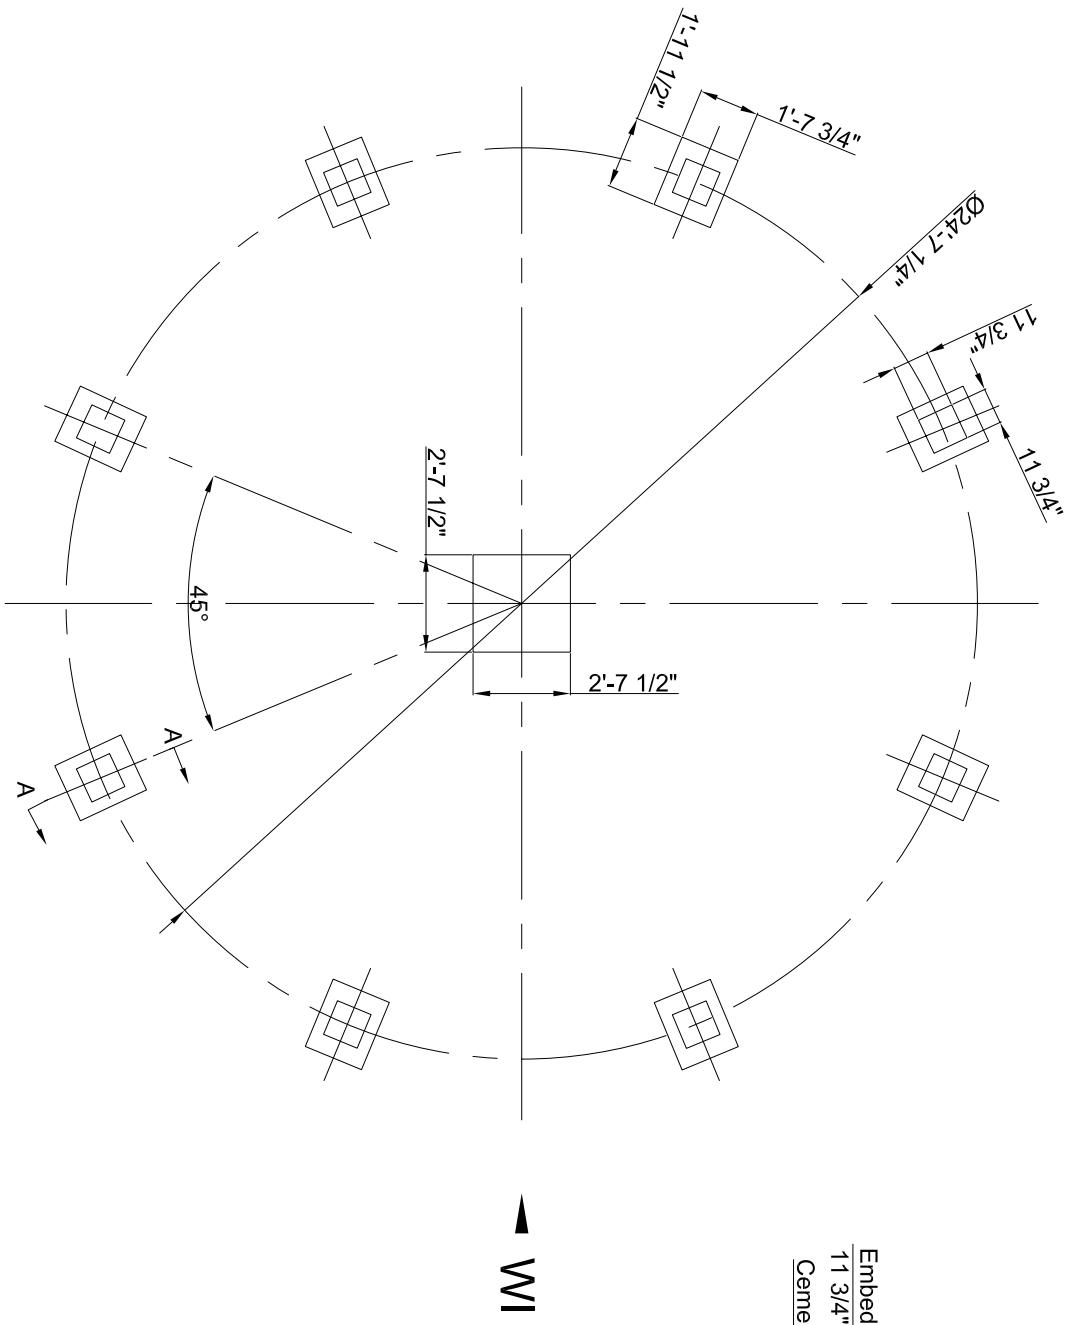

Remark:

1. The foundation and the support of center sump are at the same level.
2. The height deviation should less than 1/4".
3. Final foundation design must be determined considering the pump's NPSHR.
4. The operating weight is 39584 lbs.

PROJECT / MODEL			
			
MKT-700 FOUNDATION			
TITLE			
MESAN COOLING TOWER			
DRAWN BY xin	DESIGNED BY xin	CHECKED BY Alice	APPROVED BY Isa
SCALE 1:100	FILE NAME MKT-700	DATE 2012-05-03	REVISION 01