


The height of the foundation should be set according to the water outlet pipe diameter.



Ø1/2"X5" anchor bolts (16 places)
By customer

- Remark:**
- 1、 The foundation and the support of center sump are at the same level.
 - 2、 The height deviation should be less than 1/4" .
 - 3、 Final foundation design must be determined considering the pump's NPSHR.
 - 4、 Location of anchors is approximate and final location must be verified on-site by the installer .
 - 5、 The cooling tower foundation is designed and manufactured by customer.

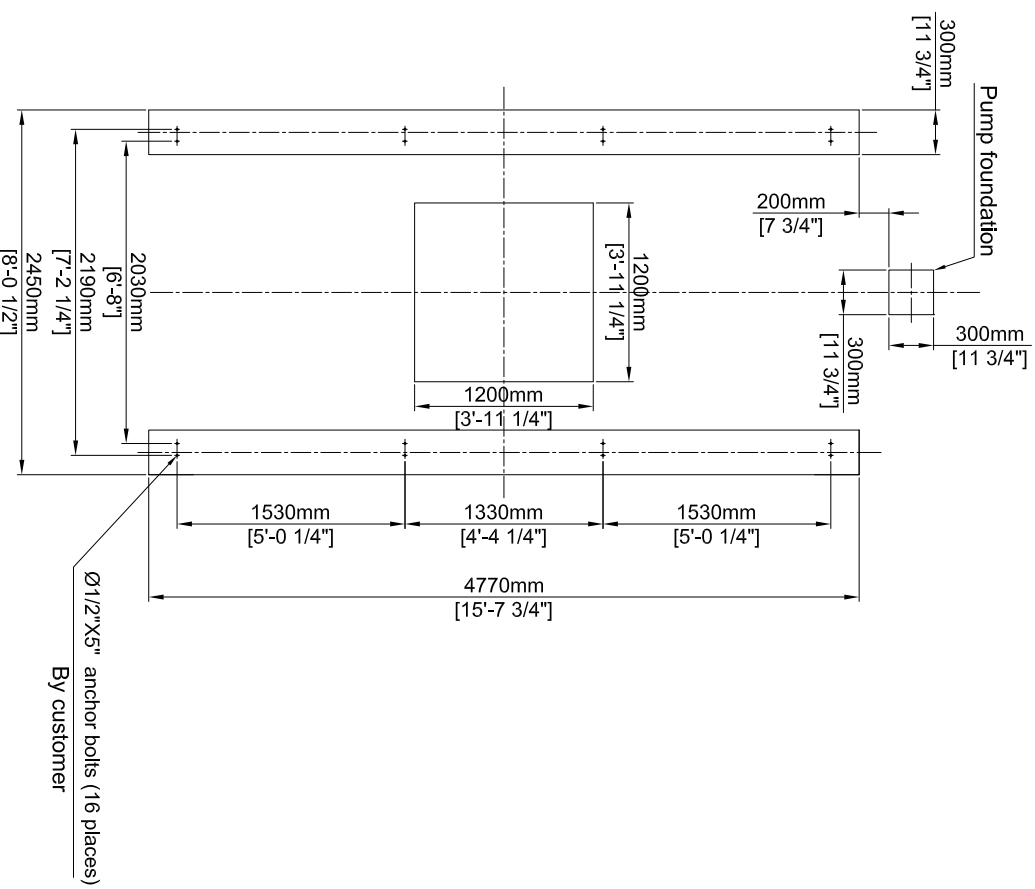

PROJECT / MODEL

MXC-02 FOUNDATION

TITLE

MESAN COOLING TOWER

DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
MING	MING	ISA	ISA
SCALE	FILE NAME	DATE	
		2012.12.01	
	DRAWING NO.	REVISION	
	MXC-02-F	01	

