



WO 10"

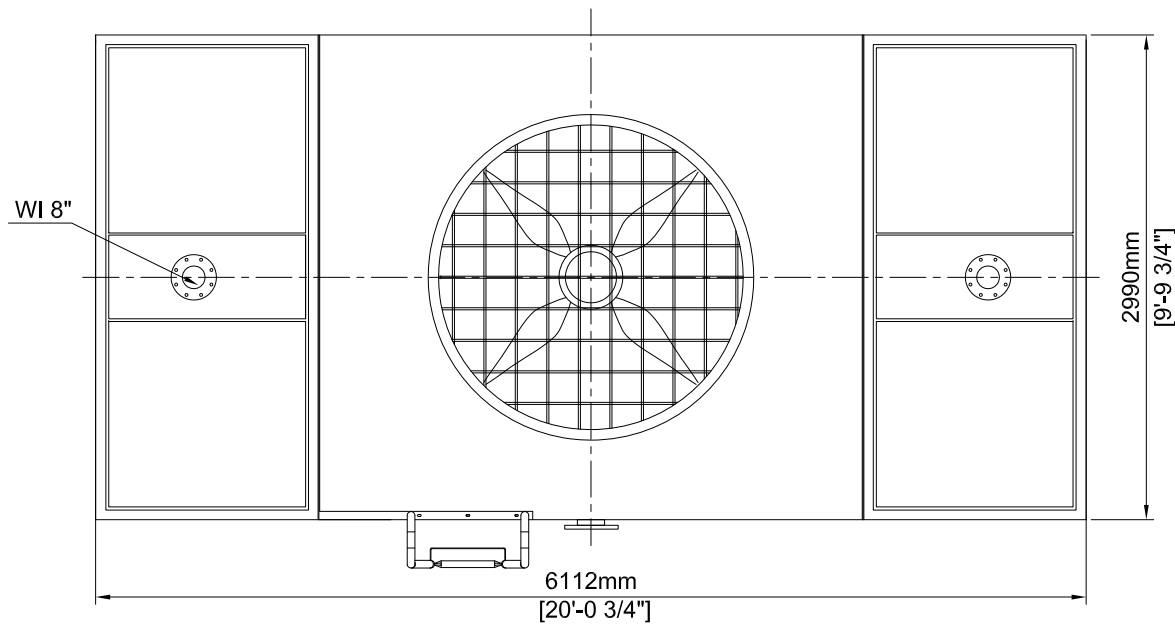

WI 8"

Notes:

1. Satisfactory performance of the cooling tower is based on precise selection, proper system design and installation in clean and well-ventilated locations.
2. For special conditions, please consult the manufacturer.

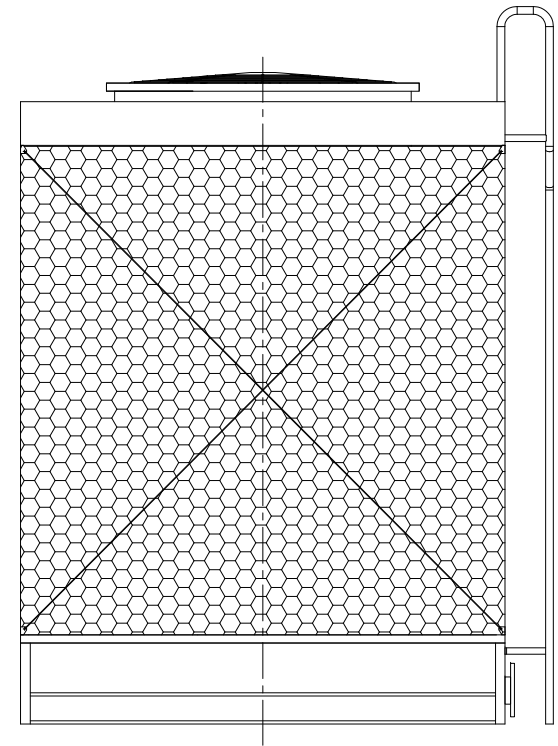

PROJECT / MODEL

MXL-03C LAYOUT

TITLE

MESAN COOLING TOWER

DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
XIN	XIN	ISA	ISA
SCALE	FILE NAME	DATE	
		2013.12.20	
	DRAWING NO.	REVISION	
	MXL-03C-L	01	