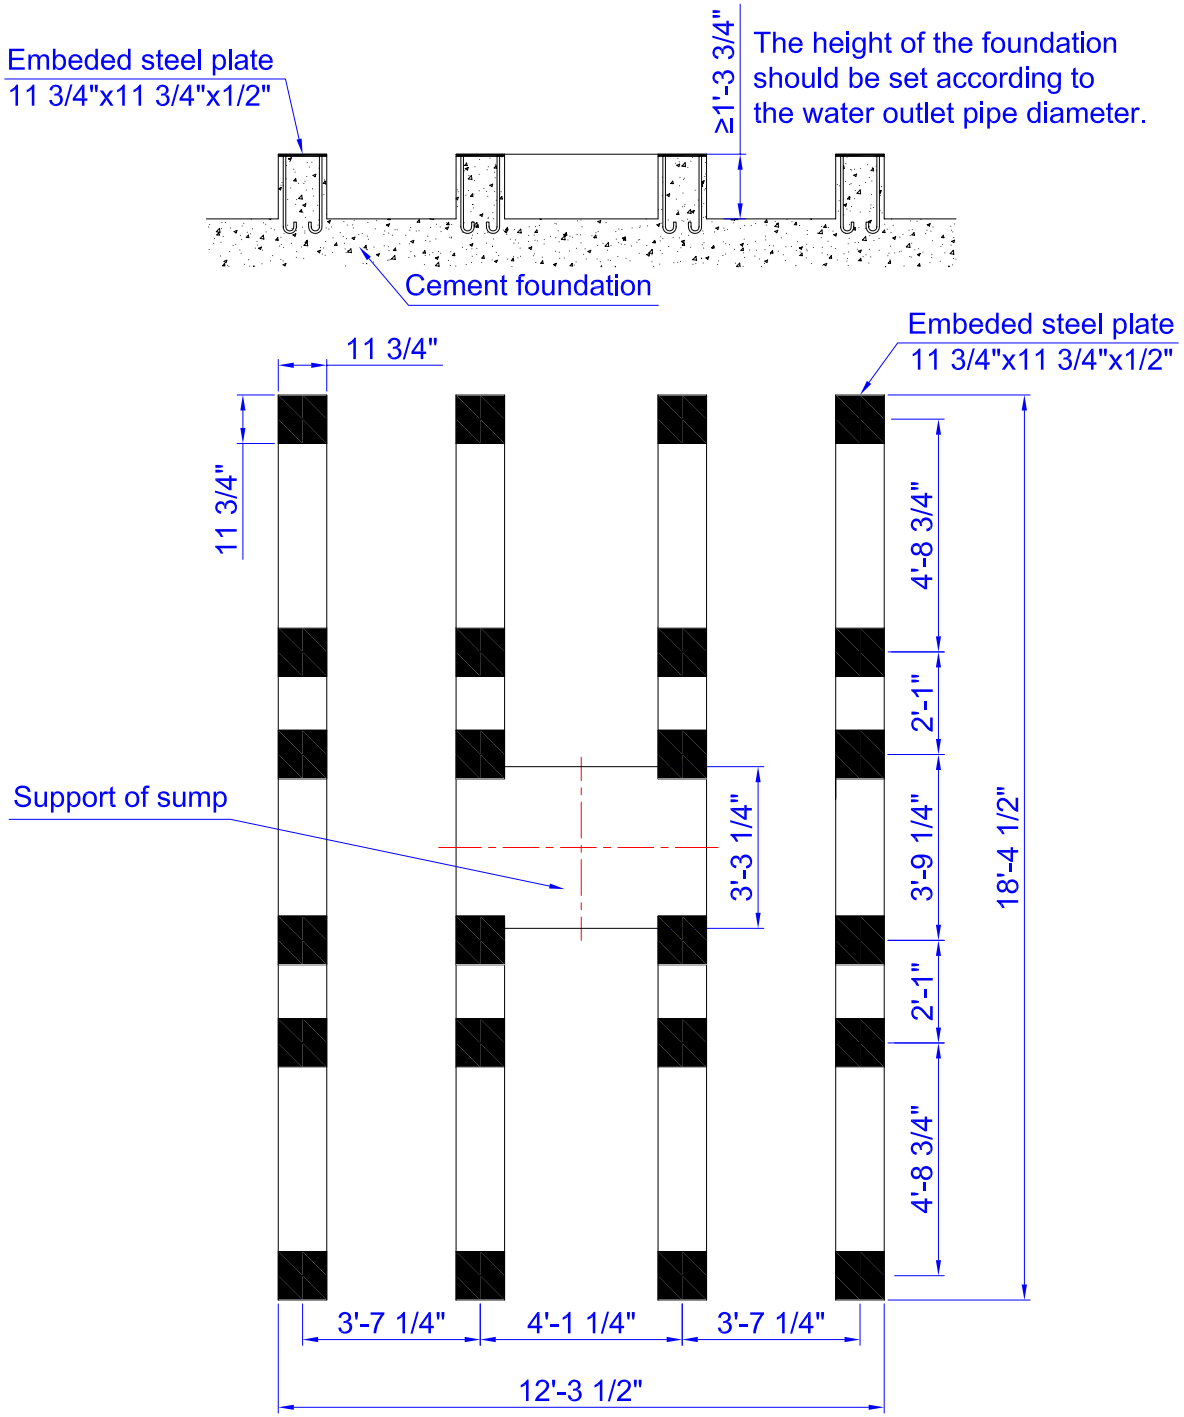

Remark:

1、The foundation and the support of center sump are at the same level.

2、The height deviation should less than 1/4".

3、Final foundation design must be determined considering the pump 's NPSHR

PROJECT / MODEL: MXR-KM-F2-18.5 FOUNDATION			
TITLE: MESAN COOLING TOWER			
DRAWN BY: Xin	DESIGNED BY: Xin	CHECKED BY: Alice	APPROVED BY: Isa
SCALE	FILE NAME		DATE: 2012-05-03
	DRAWING NO.		REVSION: 01