


Remark:


- 1、 The foundation and the support of center sump are at the same level.
- 2、 The height deviation should less than 1/4".
- 3、 Final foundation design must be determined considering the pump's NPSHR.
- 4、 Location of anchors is approximate and final location must be verified on-site by the installer.



PROJECT / MODEL
**MCC-02B
 FOUNDATION**

TITLE
MESAN COOLING TOWER

DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
KING	MING	MING	ISA
SCALE	FILE NAME	DATE	
		2014-01-06	
	DRAWING NO.	REVISION	
	MCC-02B-F	01	

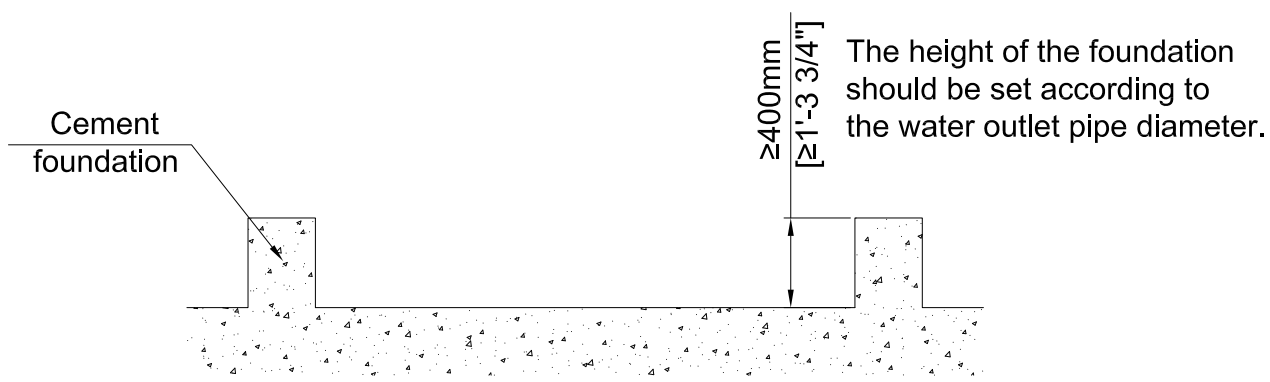

SECTION A-A