


A  
water outlet

≥400mm  
[≥1'-3 3/4"] The height of the foundation should be set according to the water outlet pipe diameter.

Cement foundation

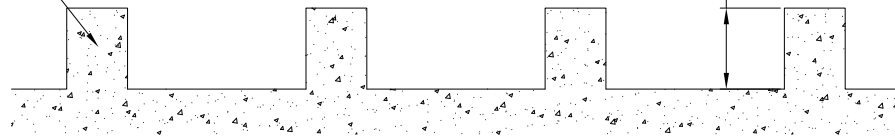

SECTION A-A

Remark:

- 1、 The foundation and the support of center sump are at the same level.
- 2、 The height deviation should less than 1/4".
- 3、 Final foundation design must be determined considering the pump's NPSHR.
- 4、 Location of anchors is approximate and final location must be verified on-site by the installer.



PROJECT / MODEL

# MCC-14B FOUNDATION

TITLE

## MESAN COOLING TOWER

DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY
KING	MING	MING	ISA
SCALE	FILE NAME	DATE	
		2014-01-05	
DRAWING NO.			REVISION
MCC-14B-F			01