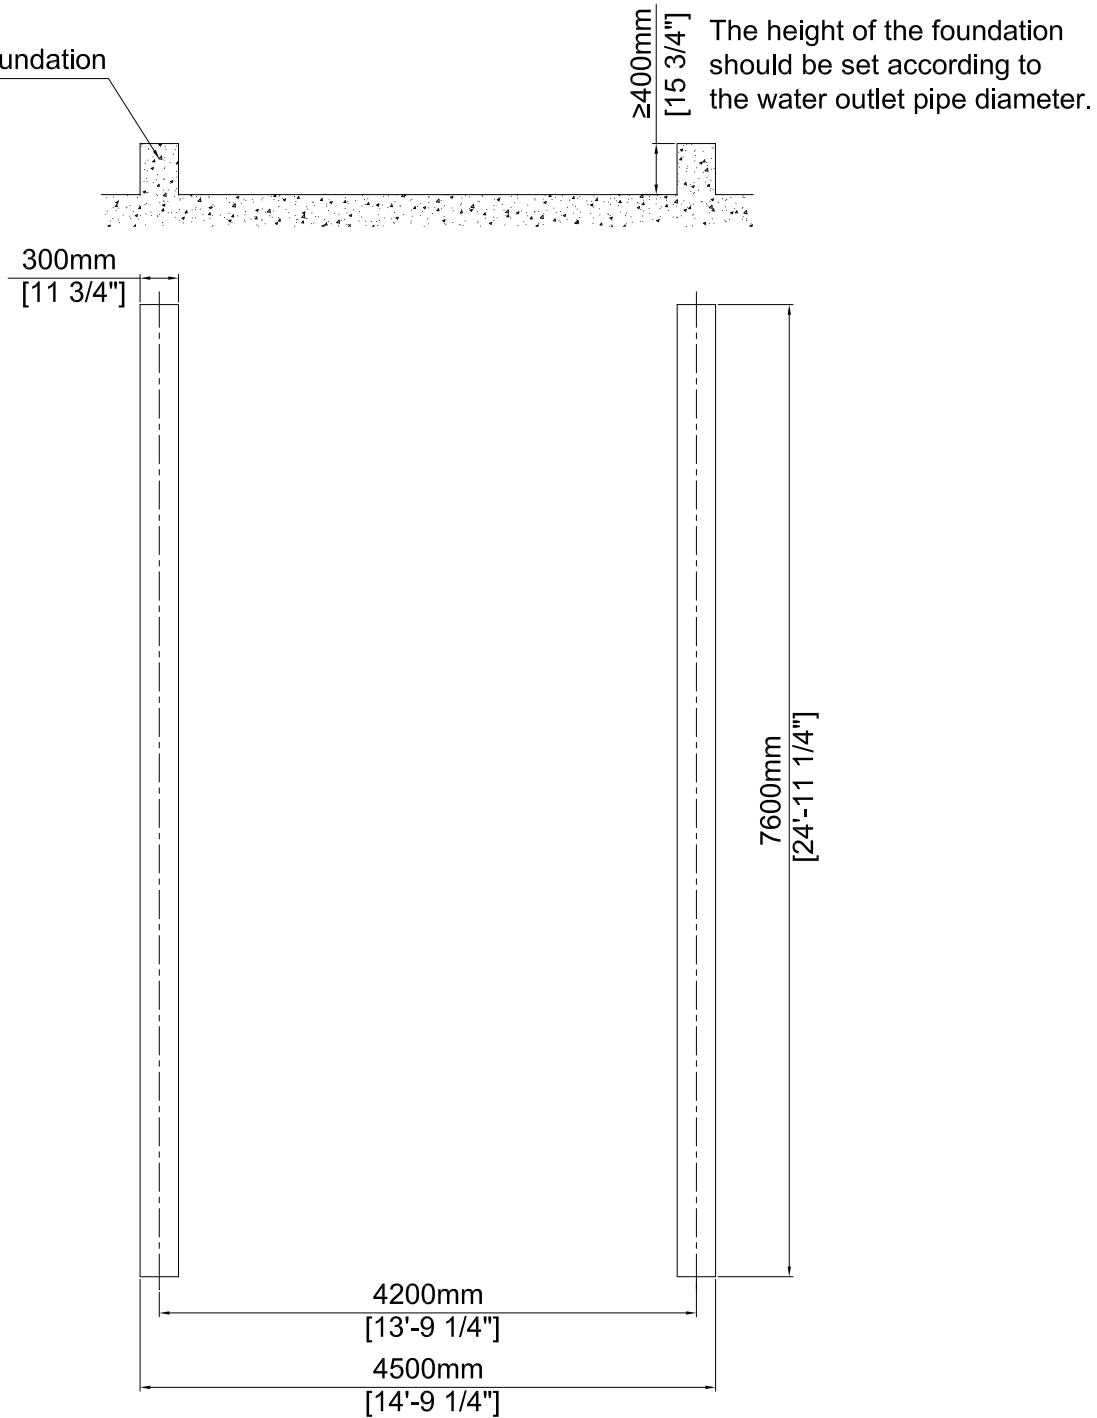




Cement foundation



**Remark:**

- 1、 The foundation and the support of center sump are at the same level.
- 2、 The height deviation should less than 1/4".
- 3、 Final foundation design must be determined considering the pump's NPSHR.

|   |             |            |             |
|---|-------------|------------|-------------|
|  |             |            |             |
| PROJECT / MODEL   |             |            |             |
| <b>MXL-05B<br/>FOUNDATION</b>   |             |            |             |
| TITLE   |             |            |             |
| MESAN COOLING TOWER   |             |            |             |
| DRAWN BY  | DESIGNED BY | CHECKED BY | APPROVED BY |
| KING  | VINCENT     | VINCENT    | ISA         |
| SCALE   | FILE NAME   | DATE       |             |
|   |             | 2013-12-19 |             |
|  | DRAWING NO. | REVISION   |             |
|   | MXL-05B-F   | 01         |             |